
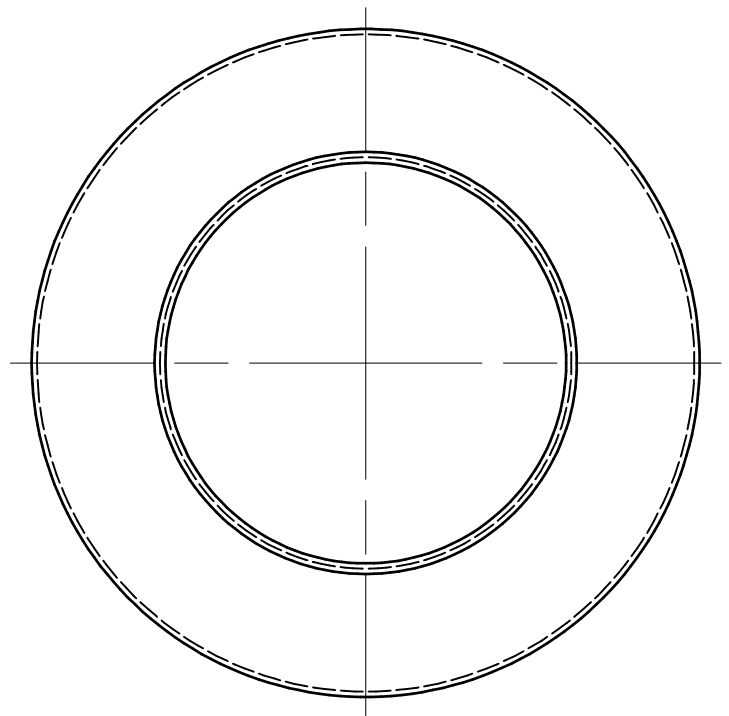
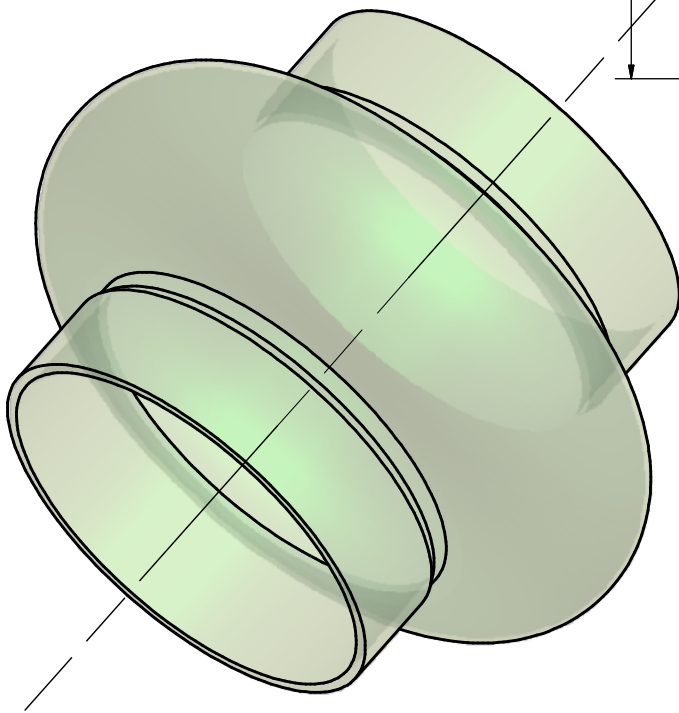


JF1000 Translucent Silicone Single Convoluted Bellows

Bellow Ref	Dimension A	Dimension B
3 inch	125	75
4 inch	150	100
6 inch	200	150
8 inch	250	200
10 inch	300	250

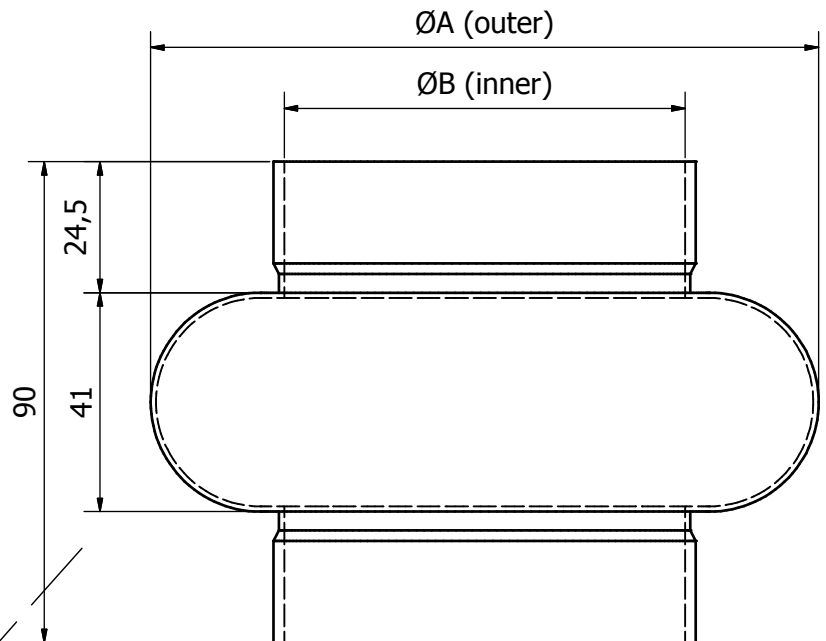

Disclaimer: All recommendations and information contained in this specification sheet are to the best of our knowledge correct. Since conditions of service are beyond our control, users must satisfy themselves that the products are suitable for intended use. No warranty is given or implied in respect of information or recommendations or that any use of products will infringe rights belonging to other parties. In any event or occurrence our liability is limited to the invoice value of our goods delivered to you. We reserve the right to change product design and properties without notice.

J-FLEX Innovative Rubber Solutions

Units 1 & 2, London Road Business Park, Retford, Nottinghamshire, DN22 6HG, United Kingdom

tel: +44 (0) 1777 712400 fax: +44 (0) 1777 712409 email: sales@j-flex.com web: www.j-flex.com



Certificate No. RS 27920



Test Report: JF1000 Translucent Silicone Single Convuluted Bellows

Material: SIL60			
Test item: ASTM D2000 M5GE 606 A19 B37			
Test		Test No.	
Normality Test	Unit	Standard	Result
Hardness	Shore A	60±5	60
Tensile Strength	Psi	min 870	975
Elongation	%	min 200	290
Compression Set (22hrs@ 175°C) B37	%	max 25	20
Heat Age (22hrs@ 175°C) A19			
Hardness Change	point	max +10	+4
Tensile Change	%	max -25	-18
Elongation Change	%	max -30	-20

These bellows have been fully post cured and all the ingredients used to produce these bellows are listed in FDA 21 CFR 177. 2600. We manufacture our FDA materials in accordance with FDA guidelines set out in 21 CFR 177.2600 and the manufactured materials have been tested to, and comply with the tests listed in 21 CFR 177.2600 (d) to (h). This makes them suitable for contact with dry, aqueous and fatty foods defined by the FDA. As stated in 21 CFR 177.2600 it is recommended that the manufactured article is thoroughly cleansed prior to first use in contact with food.

Disclaimer: All recommendations and information contained in this specification sheet are to the best of our knowledge correct. Since conditions of service are beyond our control, users must satisfy themselves that the products are suitable for intended use. No warranty is given or implied in respect of information or recommendations or that any use of products will infringe rights belonging to other parties. In any event or occurrence our liability is limited to the invoice value of our goods delivered to you. We reserve the right to change product design and properties without notice.

J-FLEX Innovative Rubber Solutions

Units 1 & 2, London Road Business Park, Retford, Nottinghamshire, DN22 6HG, United Kingdom

tel: +44 (0) 1777 712400 fax: +44 (0) 1777 712409 email: sales@j-flex.com web: www.j-flex.com



Certificate No. RS 27920

